

राष्ट्रीय पादप जीनोम अनुसंधान संस्थान

अरुणा आसफ अली मार्ग, एन.आई.पी.जी.आर. परिसर, नई दिल्ली – 110 067

फ़ोन: 26735161, 26735138, फ़ैक्स: 26741658

ईमेल: engineering@nipgr.ac.in वेबसाइट: www.nipgr.ac.in

फ़ाइल संख्या: एन.आई.पी.जी.आर./इंजीनियरिंग/5/12/2018-19

दिनांक: 07.01.2019

CORRIGENDUM

Name of work: Supply, Installation, Testing & Commissioning of High Precision A.C. in Lab 008 for Metabolome Facility at NIPGR Campus, New Delhi.


The following additions / amendments are hereby incorporated in the Tender No. 2018_NIPGR_423997_1

1. Part-A & B High Side work and Low Side work item No. 1 – **High side work includes SITC of High side equipment. Low Side equipment includes low side equipment's along with accessories required to make system functional. Also, no existing machine is to be installed.**
2. The CFM required for 10 TR machine is 5000 to 5500 and The CFM required for 7.7 TR machine is 3500 to 4000.
3. The revised layout of lab is enclosed.

All other conditions shall remain unaltered.

 सलाहकार अभियंता

POSITION-2
PRECISION AC

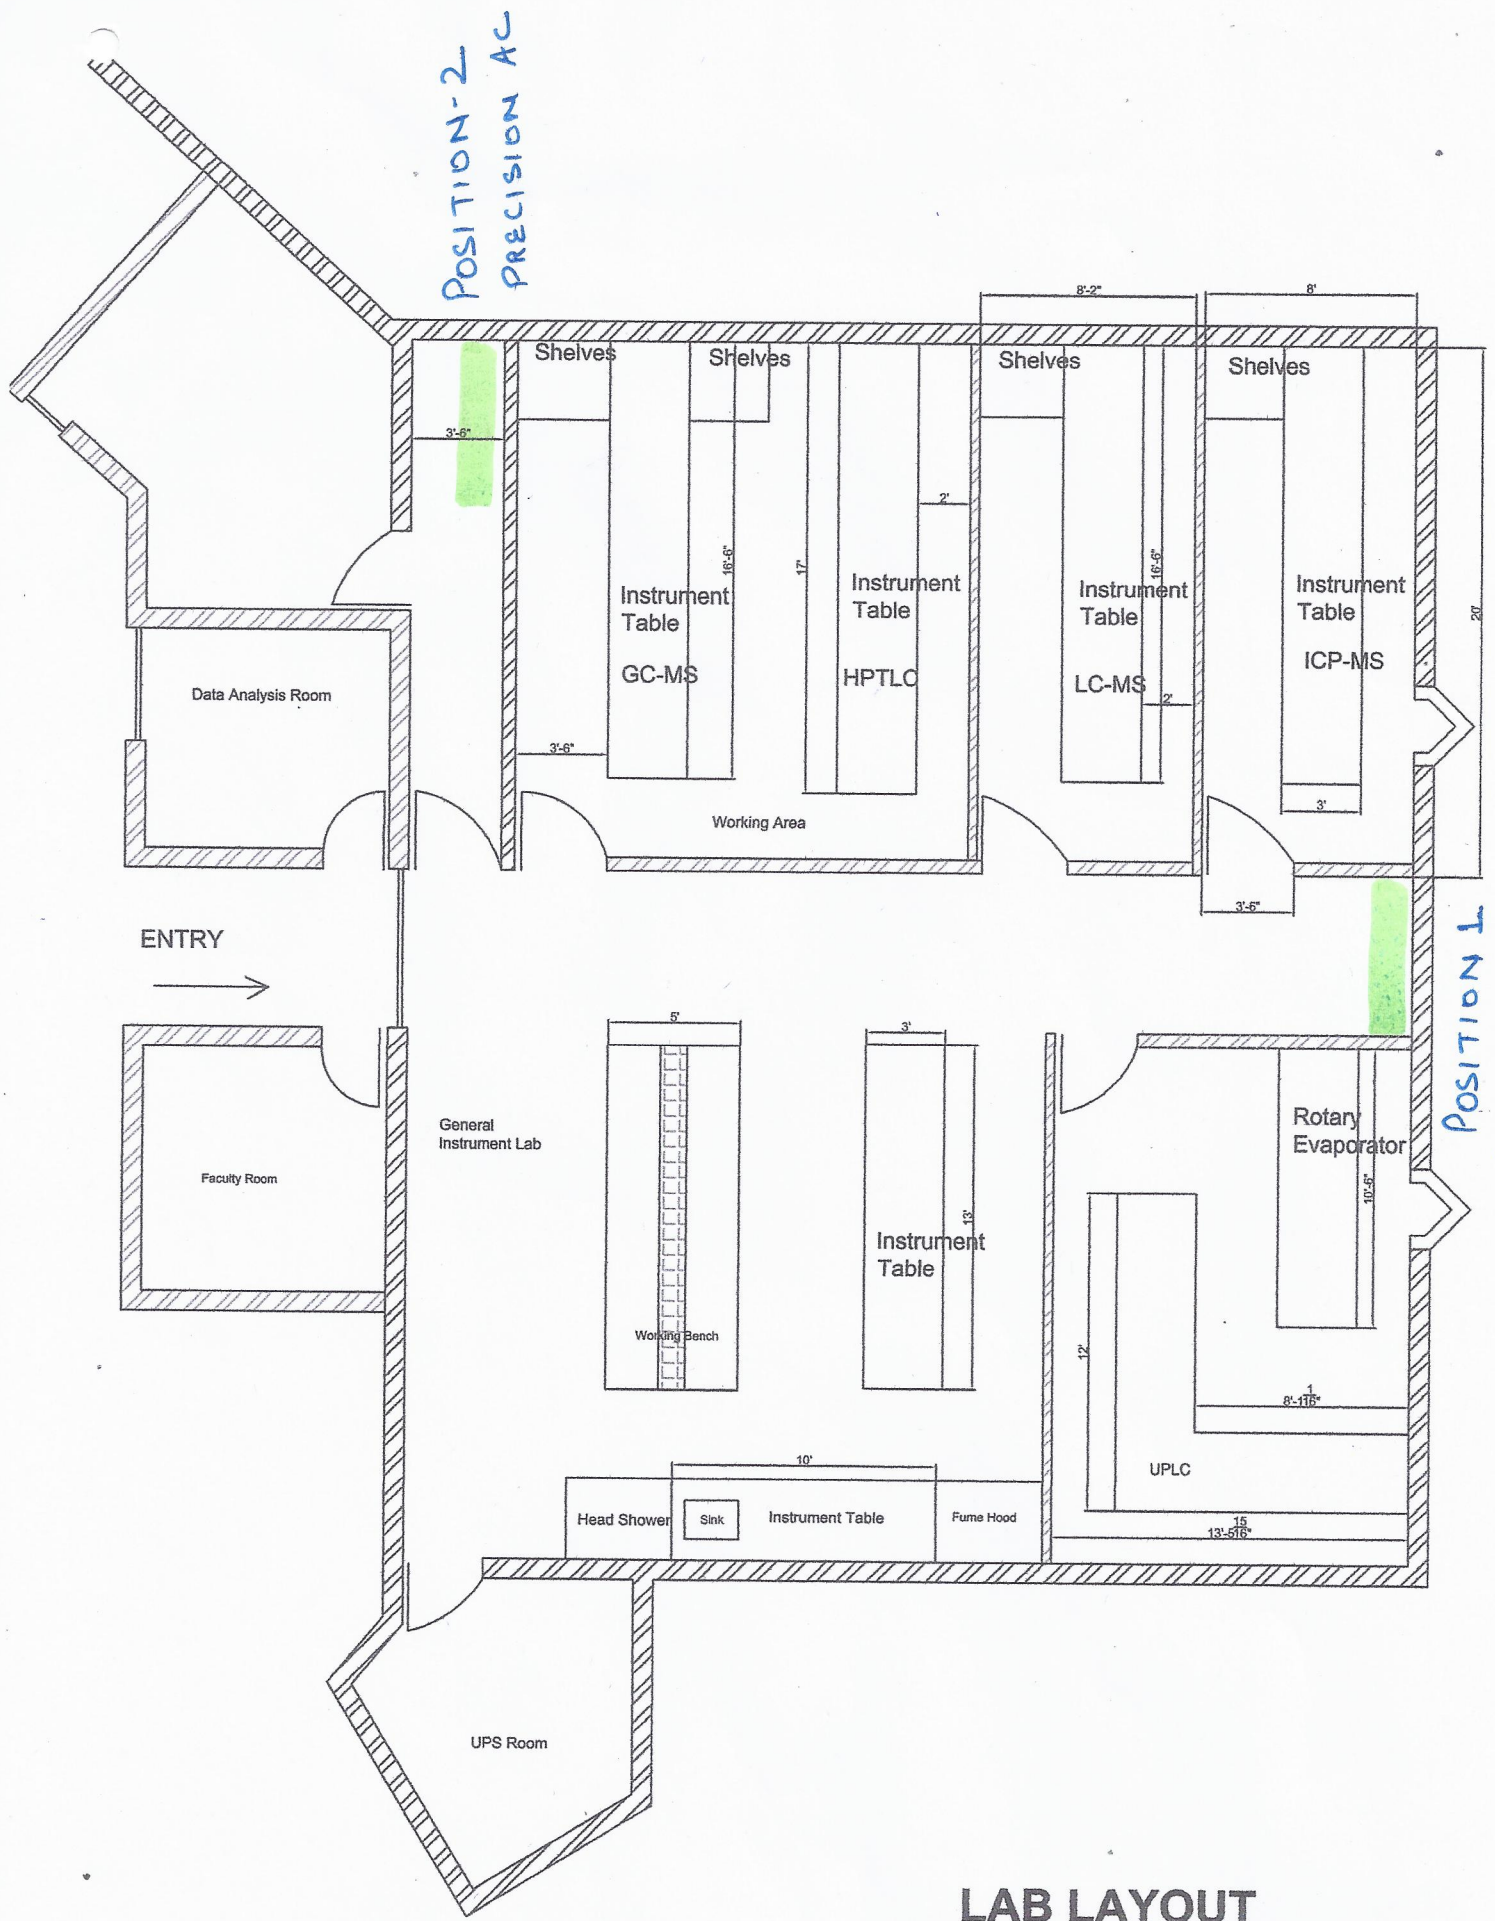

POSITION 1
PRECISION AC

LAB LAYOUT